

Fast Energy Loss Computation and Fuzzy-Based Shunt Capacitor Insertion

Dr. W. F. Mohammad, Dr. N. Tawalbeh

*Electrical Engineering Dept.
Al-Isra Private University, Jordan
wagah_aljubori@yahoo.com
nabiltawalbeh@yahoo.com*

Dr. K. M. Al-Aubidy

*Computer Engineering Dept.
Philadelphia University, Jordan
kma@philadelphia.edu.jo*

Abstract:

Fast energy loss computation is implemented using supervisory control and data acquisition system (SCADA) with personal computer. Logic Control Array (LCA) and EPROM circuits are used to implement SCADA system and to measure the Volt-Ampere, KVolt and KVAR and draw the daily load curve for residential and commercial customers. LCA, EPROM and PC are used to simplify the electronic circuits, reduce the cost and speed up the computation time.

An illustrative example was done to measure, store and show the active power, reactive power, load voltage, load current, power factor, and the shunt capacitors current. It is found that when 2.7 MVAR bank capacitor is inserted in the network the load current is decreased from 740.8A to 688.4A and the power factor is improved from 80% up to 93%, and led to add more loads on the network and release the feeder capacitor.

A rule-based fuzzy decision maker has been designed and tested with the real data collected from Jordan using SCADA system. The calculated output is almost similar to that obtained from the first approach presented in this paper. The advantage of using fuzzy decision maker is its simplicity that can be implemented on a programmable logic device and can be programmed to improve the power factor.

Keywords: Energy loss computation, Power factor improvement, Intelligent systems, Fuzzy logic, Fuzzy decision maker, Rule-based system.

Introduction:

Capacitors are widely used in distribution system to achieve power and energy loss reduction, and to maintain the voltage profile with impermissible limits and to minimize the voltage flicker in power distribution networks. The extent of these benefits depends on the location, size, type, and number of capacitors and the fast method of capacitor insertion [1, 2, and 3]. The power factor depends on the electrical loads type; it is usually that the current lagging voltage and the angle of lagging are varied as the load varied and the daily time elapse. Increasing the lagging will cause more energy loss in the distribution network. This problem has been treated by inserting shunt capacitors in the distribution network which is essentially reduces the current flow.

If the daily energy losses are evaluated the different load patterns of daily local current (DLC) of different customers should be taken into account. The customers are divided into three groups: Urban residential, commercial and industrial. Each type of load has its typical DLC set for twenty four hours at working days. The fast method of total energy loss calculation can be manipulated using supervisory control and data acquisition system

(SCADA), with personal computer [4, 5]. Data acquisition operation includes measurements of voltages, load currents, power factors and power capacitor currents, also estimate power and reactive power for main transformer. An electronic circuit based on Logic Control Array (LCA) has been designed and build to do all the measurements and insert the required shunt capacitors at the right time and allocation.

To find the optimal solution of the above formulated complicated combinational problem, the fuzzy logic is used which imitates the process of natural evolution. This optimization tool proved to be very successful for capacitors evaluation and insertion [6, 7, and 8]. A special feature of the fuzzy set approach is that it is capable of dealing with uncertain and linguistic terms such as “heavy load” to describe system loading condition. It is also suitable as a decision maker.

Power factor correction

As mentioned earlier, the fundamental function of shunt capacitors to regulate the voltage and reactive power flows at the point where they are inserted, in other words they are changing the power factor of load. In typical distribution loads, the current lags the voltage; the cosine of the angle between current and voltage is known as the power factor of the circuit. Figure 1 illustrates the power factor correction for a given system. Capacitors draw leading reactive power from the source; i.e. they supply lagging reactive power to the load:

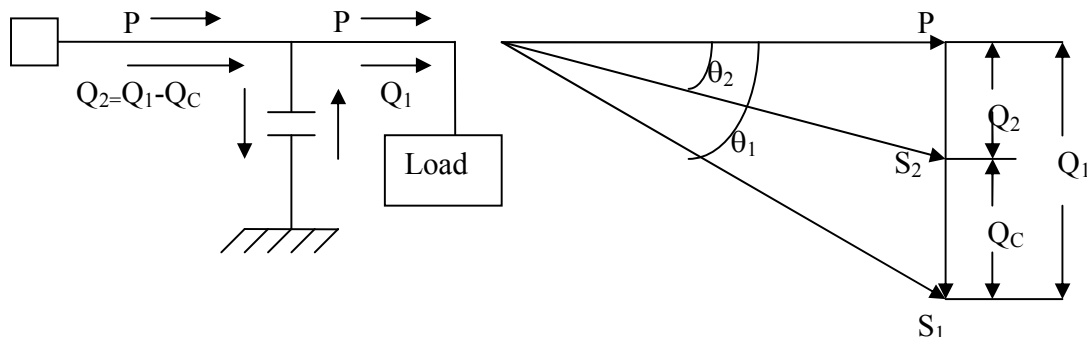


Fig (1): Illustration of power factor correction

Assume that a load is supplied with a real power P , lagging reactive power Q_1 , and apparent power S_1 at a lagging power factor of:

$$\cos \theta_1 = \frac{P}{S_1} = \frac{P}{[P^2 + Q_1^2]^{\frac{1}{2}}} \dots\dots\dots(1)$$

When a shunt capacitor of Q_c KVA is installed, the power factor can be improved from $\cos \theta_1$ to $\cos \theta_2$ when:

$$\cos \theta_2 = \frac{P}{S_2} = \frac{P}{[P^2 + (Q_1 - Q_c)^2]^{\frac{1}{2}}} \dots\dots\dots(2)$$

Therefore, as can be observed from the above figure, the apparent power and the reactive power are decreased from S_1 KVA to S_2 KVA and from Q_1 KVAR to Q_2 KVAR (by providing a reactive power of Q_c) respectively.

The economic power factor is the point at which the economic benefits of adding shunt capacitors just equals the cost of capacitors. Today's high plant and fuel costs have pushed the economic power factor toward unity. Here you need to be careful that as a lagging system power factor is detrimental to the system on various counts, a leading system power factor is also undesirable. It tends to result in overvoltages, higher losses and lesser capacity utilization. For the above reasons fast energy loss computation and efficient method of inserting and removing the shunt capacitors must be implemented.

Many power-factor-correction tables can be tabulated [9] using personal computers to simplify the calculations involved in determining the capacitor size necessary to improve the power factor of a given load from original to desired value. The capacitor size (Q_c in KVAR) is:

$$Q_c = P_L (\text{Correction factor}) \dots\dots\dots (3)$$

Where P_L is the real power load. A load flow digital computer program (will be discussed and explained later) can be employed to determine the KVolt-Ampere, KVolt and KVAR at annual peak level for the distribution substation. As a result of local flows program runs, the system's lagging reactive loads (i.e. power demands) can be determined and the results can be plotted on curve as shown in figure 2. This curve is called the reactive load duration curve, once the daily reactive load duration curve is obtained, then by visual inspection of the curve the size of the fixed capacitor can be determined to meet the minimum reactive load, the high and variable remaining demands of the loads are met by the switched capacitors.

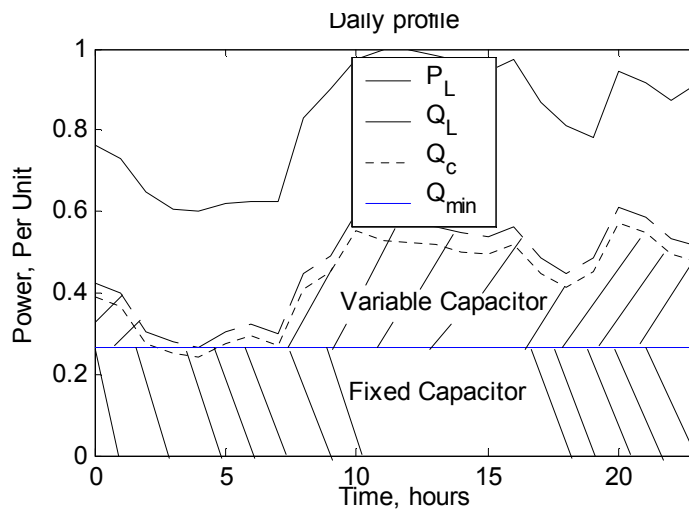


Fig (2): Sizing of the fixed and switched capacitors

To meet the daily reactive power and switched capacitors many utilities apply the rule of thumb to determine the size of the switched capacitor. In this research a very fast

computation system based on SCADA system is used to find the reactive load duration curve for residential, commercial and industrial customers at weekdays. Then a fuzzy logic is used to determine the size of switched capacitors.

Power factor measurement using SCADA system:

Supervisory control and data acquisition (SCADA) system could be considered as one of the most recent technologies used on data collection and control for distribution power system. Figure 3 shows the block diagram of data acquisition system to measure the kilovolt-amperes, kilovolts and kilovars at daily reactive load curve. Logic control Array (LCA) is used to control the input and output circuit of the personal computer (PC). For more details see reference [10]. LCA type XC3030 is used to reduce the electronic circuits, the cost and speed up the measurements operation. LCA (XC3030) consists of more than 100 configurable logic blocks and can capacitate more than 22 kilobyte, and it is connected to 27C64 EPROM that capacity of 8 Kbytes which store the data, perform and allocate the logic circuits inside LCA. This operation called LCA programming used the ready software supplied with the device.

The final circuits which consist of set of power transistors (BC337-40) are controlled by the LCA output signal to drive the relays which insert or disconnect the shunt capacitors.

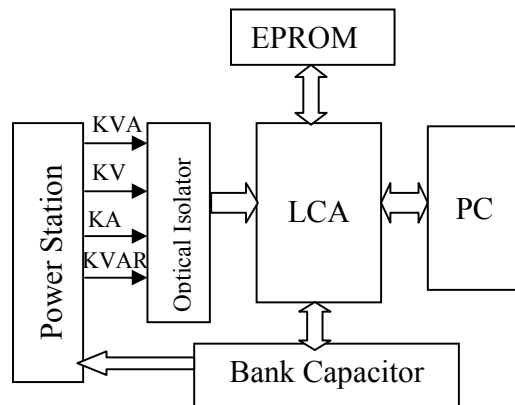


Fig (3): block diagram of data acquisition system.

As start, shunt capacitors are applied to each substation bus for correcting to an initial power factor, for example, 90 percent. Then, a load flow run is performed to determine the total system Kilovolt-amperes, and kilowatt losses at this level and capacitors kilovars are noted. Later additional capacitors are applied to substation bus under test to increase the power factor by 1 percent, and another load flow run is made. This process of iteration is repeated until the power factor becomes unity. The additional capacitor size required can be calculated as:

$$\Delta Q_C = P_{PK} (\tan \phi - \tan \theta) \dots \dots \dots (4)$$

Where ΔQ_C is the required capacitor size in KVAR P_{PK} is the system demand at annual peak in KW, $\tan \phi$ is the tangent of original power factor angle and $\tan \theta$ is the required power factor angle.

Illustrative example:

To verify the proposed method of shunt capacitor insertion the measurements of daily peak load P_{dp} at single feeder fed by 33 / 11KV, 16 MVA substation transformers were made from August to July. The program has the ability to measure, store and show the active power, reactive power, load voltage, load current, power factor, and the shunt capacitor current, every ten seconds. For this reason capacitor can be inserted in the power network in no time, and the power loss can be reduced to minimum.

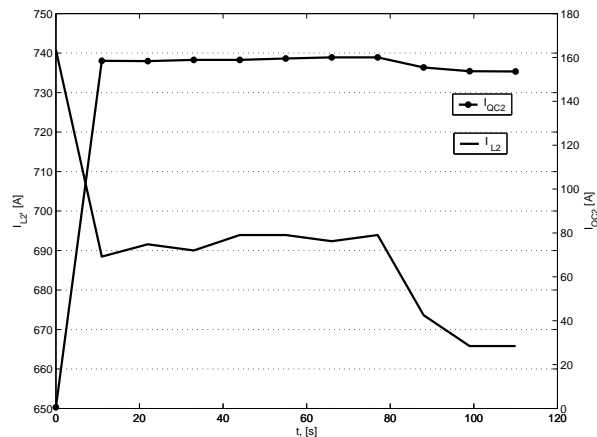


Fig (4): Variation of I_L and I_{QC} with time before and after capacitor insertion.

Figure 4 represents variation of load current (I_L) and shunt capacitor current (I_{QC}) after 10 second when a bank capacitor of 2.7 MVAR inserted in the network.. If you inspect the figure carefully, you can noticed that at time=0, $I_{QC}=0A$ and $I_L= 740.8A$. When the bank capacitor of 2.7 MVAR is inserted at time $t=10$ seconds the currents $I_{QC} = 158.47A$ and $I_L = 688.44A$. It is very interesting to notice that when shunt capacitors are inserted in the network will draw a lead current from the (substation) transformer and supply a lagging current to the load. The load current will decrease consequently; the total substation transformer current will be decreased. The power factor is improved from 80% up to 93.6%, and this leads to add more loads on the network and release the feeder capacity.

Figure 5: represents the daily peak loads for different customers (residential, commercial, and industrial) for working days. The measurements were taken at substation transformer of 132/33 KV, 40 MVA power, during April-June.

Figure 5 represents the daily peaks loads for different customers (residential, commercial and industrial) for workdays. The measurements were taken of the substation transformer of 133/33 KV, 40 MVA. It is very interesting to notice that there is a lot of differences between the customers. In residential the fixed reactive power is around 37% of the maximum reactive power and it occurs around seven o'clock at the morning. On the other hand there is no fixed reactive power for the commercial and becomes minimum for long time of the day namely between 00:00 and eight o'clock at the morning and it is maximum on the other times of the day. The story from the industrial daily load profile is quite different. At first the constant reactive power is quite high around 67% of the maximum reactive power. Also the variable reactive power is quite changeable. These changeable events occur during all the hours' day and nights. From the above inspection, it is understandable that different feeders must be used for different type of customers in

order to insert the right values of the shunt capacitors in the networks, rather than putting identical units of bank capacitors at all networks, which will be never used sometime or could be more than what is needed and that will the power factor leading , which result in over-voltages and higher losses.

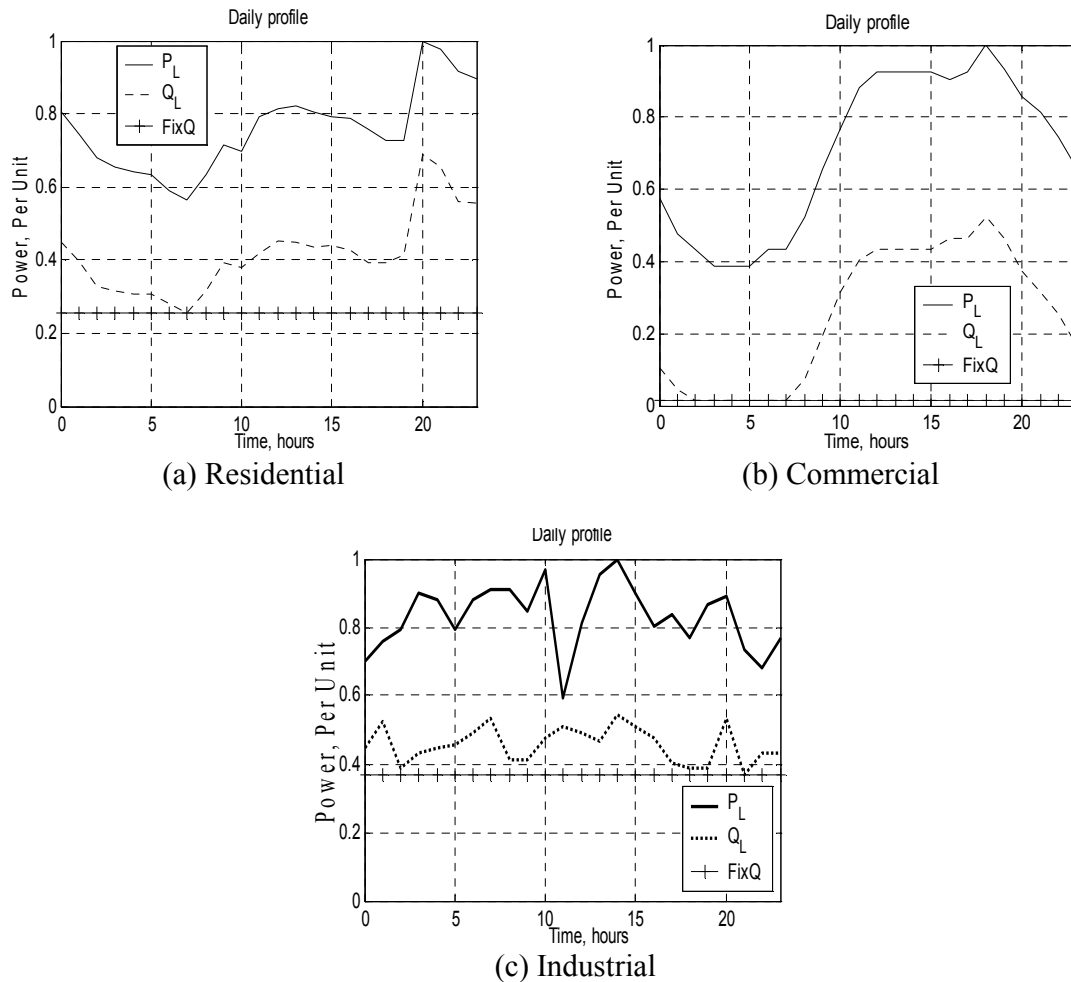


Figure (5): Active and reactive power of the transformer for twenty four hours for different customers; (a) Residential, (b) Commercial, (c) Industrial

Application of fuzzy regression analysis of shunt capacitor insertion:

One year after the electronic circuit designed and used for test in last section and the draft of this paper was under preparation, some researcher on fuzzy logic suggested to add a section here applying fuzzy regression of shunt capacitor insertion to improve the power factor. The answer was going on because that will simplify the electronic circuits, reducing its cost with very simple software. It is also found that the fuzzy regression do

all the uncertainty measurements and sum all the huge measurements that must be included to draw the daily load curves for different customers and identify the approximate values of shunt capacitors.

A fuzzy-based decision maker (FDM) has been proposed to compute the suitable shunt capacitor required to improve the power factor according to the measured power factor (A) and measured active power (B), as shown in Fig.(7).

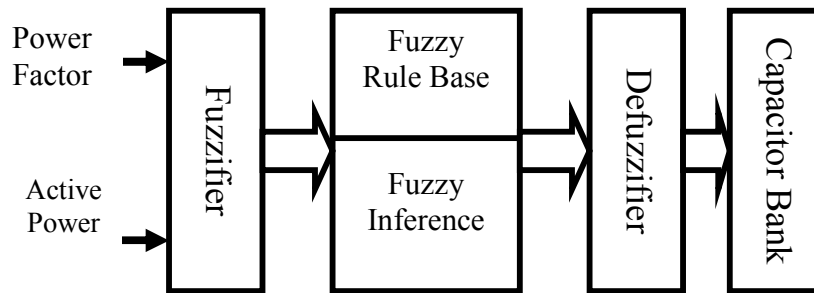


Figure 7: Fuzzy Decision Maker Layout.

The measured variables are inverted into suitable linguistic variables. In this application, the following linguistic variables are used for measured power factor (A) and calculated variable (C); Very Small (VS), Small (Sb), Medium (M), Large (L), and Very Large (VL). The fuzzy sets definition for measured active power (B) are; Very Small (VS), Small (S), Rather Small (RS), Medium (M), Rather Large (RL), Large (L), and Very Large (VL). Figure (8) shows the universe of discourse and fuzzy sets of these variables. Fuzzy sets can have a variety of shapes. However, a triangular or a trapezoid can often provide an adequate representation of the knowledge [11].

The proposed fuzzy decision maker is a collection of linguistic rules which describe the relationships between measured variables (A & B), and calculated output (C). Table (1) contains 35 rules, since we have five fuzzy sets for first input variable, and seven fuzzy sets for the second input variable. Each rule is represented by IF and THEN statement such as;

IF A is S and B is RS THEN C is M

This means that if the measured power factor is Small and the active power is Rather Small, then the fuzzy calculated output is Medium.

The Mamdani-style inference process is used[11], and the center of gravity defuzzification method is applied to convert the fuzzy output into a crisp value, Fig.(9), which is used as an index to select the suitable shunt capacitor.

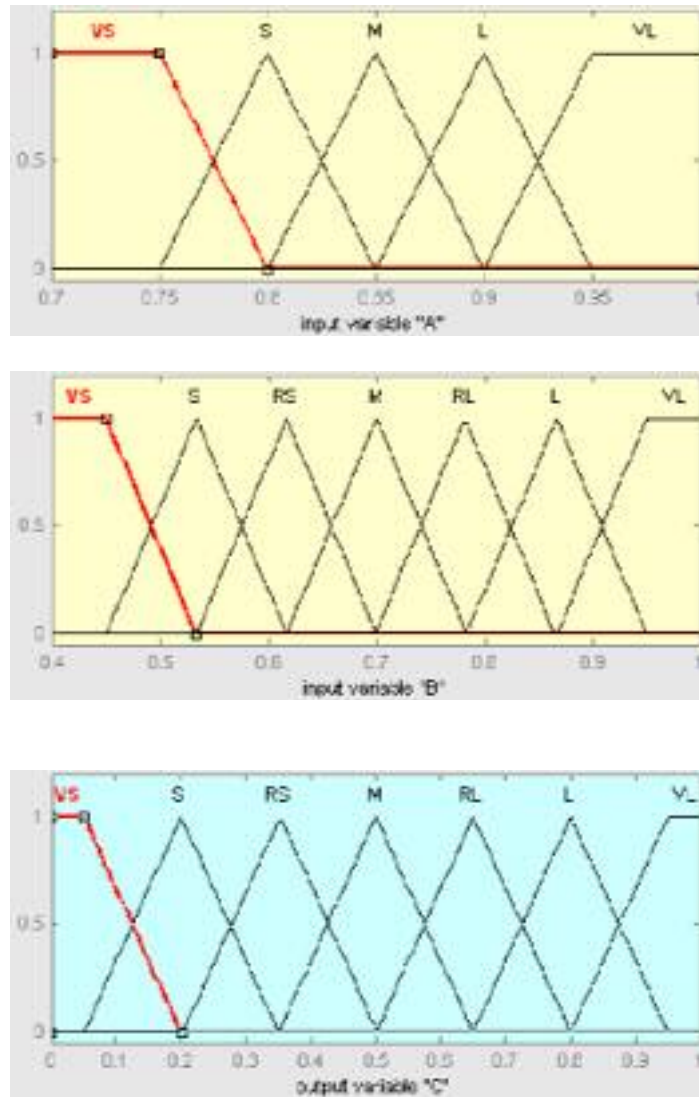


Figure 8: Universe of discourse of the variables.

A \ B	VS	S	M	L	VL
VS	S	S	S	VS	VS
S	M	S	S	S	VS
RS	M	M	S	S	VS
M	L	M	M	S	VS
RL	L	M	M	S	VS
L	L	L	M	S	S
VL	VL	L	M	M	S

Table 1: Fuzzy Rules.

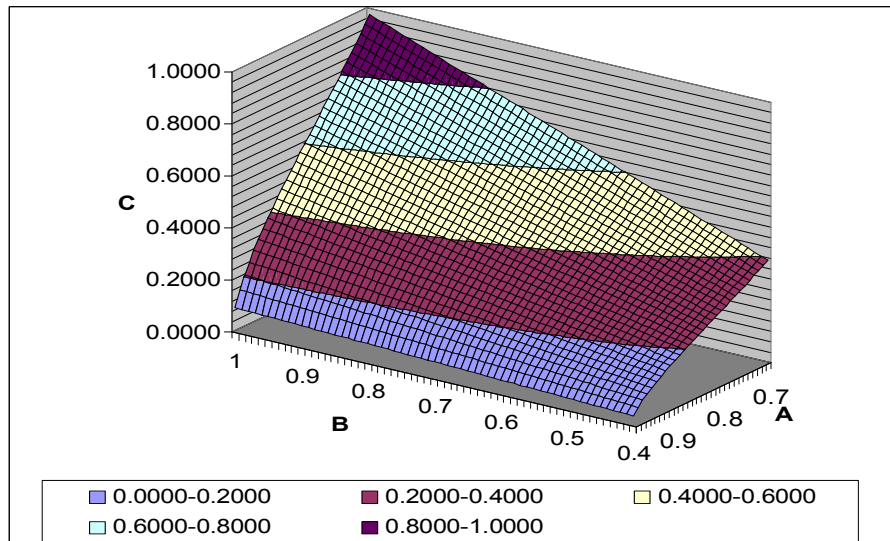


Figure 9: Control Action calculated from FDM.

Conclusions:

Fast energy loss computation has been implemented using data acquisition system. Logic control array has been used to control the input and output interface of the personal computer. The electronic circuit has the ability to measure, store and monitor the active power, reactive power, load voltage, load current, power factor, and the shunt capacitor currents. The daily peak loads for residential, commercial and industrial customers has been measured and drawn. Several differences between customers were outlined, where fixed capacitor is minimum for commercial, medium for residential and maximum for industrial customers. On the other hand, the switched capacitor is minimum for industrial, medium for residential and maximum for commercial customers. Therefore, to find the optimal solution of the above complicated combinational problem, a fuzzy-based decision maker has been used to compute the suitable shunt capacitor required to improve the power factor according to the measured parameters.

The proposed fuzzy decision maker has been tested with the real data collected from Jordan, and the calculated output is almost similar to that obtained from the first approach presented in this paper. The advantage of using fuzzy decision maker is its simplicity that can be implemented on a programmable logic device and can be programmed to improve the power factor.

References:

1. I.S. Granger and S.H. Lee, "Optimum Size and Location of Shunt Capacitors for Reduction of Losses on Distribution Feeders" IEEE Trans. Power Appar. Syst. Vol. PAS-100, no.3, PP. 1105-1118, (1981)
2. T.H. Fawzi, S.M. El-Sobki, and M.A. Abdel-Halim, "New Approach for the Application of Shunt Capacitors to the Primary Distribution Feeders", IEEE Trans. Power Appra. Syst. , Vol. PAS-102, no.1, PP. 10-13, (1983).

3. M. Ponnaivaikko and K.S. Prakasa Rao, "Optimal Choice of fixed and Switched Shunt Capacitors on Radial Distributers by the Method of Local Variations", IEEE Trans. Power Appra. Syst. , Vol. PAS-102, no.6, PP. 1607-1615 , (1983).
4. M. Kaplan, "Optimization of Number, Location, Size, Central Type, and Central Settings of Shunt Capacitors on radial Distribution Feeders", Trans . Power Appra. Syst. , Vol. PAS-103, no.9, PP. 2659-2665, (1984).
5. I. Batur and A.N Guven, " A Proposed Application of an Industrial DOS Computer for Distribution Substation Monitoring and Central", IEEE Trans. On Power Delivery, Vol. 9, no.2, PP. 729-735, April (1994).
6. M.C.F Raid , "Study and Improvement of Supervisory Control and Data Acquisition System in Distribution Station", M.Sc. Thesis, Mousel University, Iraq (2002).
7. H.C. Kuo and Y.Y Hso, " Distribution System Load Estimation and Service Restoration Using A Fuzzy Set Approach", IEEE Trans. On Power Delivery, Vol.8, no. 4, PP. 1950-1957. Oct (1993).
8. J. Nazarko and W. Zalewski, " The Fuzzy Regression Approach to Peak Load Estimation in Power Distribution System", IEEE Trans. On Power Systems, Vol.4, no. 3, Aug. (1999).
9. G. Levitin, A. Kalyuzhny, A. Shenkman, and M. Cherkov, " Optimal Capacitor Allocation in Distribution Systems Using a Genetic Algorithm and Fast Energy Loss Computation Techniques", IEEE Trans. On Power Delivery, Vol.15, no. 2, April. (2000).
10. T. Gonen, "Electric Power Distribution System Engineering", Section: Application of Capacitors Distribution systems, PP. 385-398, McGraw-Hill Inc, 1986.
11. I.S.H. Al-Abdaly (Computerized Method for Capacitor Banks Insertion to Improve Power Factor in the Distribution Substation) M.Sc. Thesis, Mousel university, Supervised by Dr. Wagah F. Mohammad, Mousel, Iraq (2003).
12. M. Negnevitsky, "Artificial Intelligence; A Guide to Intelligent Systems", Addison Wesley, USA 2005.